

## **MIS240**

DIN rail power supplies for 1-phase system AC-DC 240W



#### **Product Family Features**

Universal Input 85~264VAC;
 Support transient voltage: 305VAC/1H

Cooling by Free Air Convection

All Round Protections: SCP/OLP/OVP/OCP/OTP

LED Indicator for DC Power On; LED Indicator for DC Low

 Certified UL508/BS EN/EN61000-6-2(BS EN/EN50082-2) /UL62368(Safety)

Built-in active PFC function

150% Peak Load capability



#### **Models**

Model Number	Output Voltage	Input Voltage	Output Current	Efficiency	Ripple
MIS240-24	24V	85-264Vac	10A	93%	100mV
MIS240-48	48V	85-264Vac	5A	92%	120mV

## **Input Specifications**

Parameter	Min.	Тур.	Max.	Note
Input Voltage Range (AC)	85V	230V	264V	Support transient voltage: 305VAC/1H; Input voltage for Safety certification: 100-240VAC
Input Voltage Range (DC)	127V	-	370V	
Input Frequency	50Hz	-	60Hz	
Nominal Input Voltage	100V	-	240V	
Input current	-	-	2.8A	115Vac&full load
	-	-	1.3A	230Vac&full load
Inrush Current	-	-	50A	115Vac&full load
Cold Start	-	-	75A	230Vac&full load
Leakage Current	-	-	1mA	230Vac&full load

<sup>\*</sup> The power supply can operate with DC input. Please connect the positive terminal to the L terminal and the negative terminal to the N terminal.

## **Output Specifications**

Parameter	Min.	Тур.	Max.	Note
Output Voltage Accuracy	-	±1%	-	
Deal sument	-	-	15 A	MIS240-24
Peak current (Holding Time:3s)	-	-	7.5 A	MIS240-24
Line Regulation	-	-	±0.5%	
Load Regulation IOUT=0%~100% of IOUT,Rated	-	-	±1%	
Output Voltage adjust- range	20	-	27	MIS240-24
	44	-	53	MIS240-48

# **General Specifications**

Parameter	Min.	Тур.	Max.	Note
Temperature Coefficiency	-	-	±0.03%/°C	0~50°C
	-	-	2000mS	115Vac&full load
Turn-on time	-	-	1500mS	230Vac&full load
	-	-	20mS	115Vac&full load
Hold-up time	-	-	30mS	230Vac&full load
	60mS	-	-	115Vac&full load
Rise time	60mS	-	-	230Vac&full load
Recommended External Fuse	-	-	-	
Operating Temperature Range	-30°C	-	70°C	
Storage Temperature	-40°C	-	85°C	
Storage Humidity	20%	-	95%	non-condensing
Operating Altitude	0m - 5000m			
Case Material	Stainless steel + aluminum			
Cooling Method	Air convection cooling			
Vibration	Component: 10~500Hz, 2G 10min./1cycle, period for 60min. each along X, Y, Z axes (IEC60068-2-6)			
MTBF	230Khrs,MIL-HDBK-217F(25°C)			
Size	60*130*125mm (2.36*5.12*4.92inch)			
Weight	877g			

# Safety&EMC Compliance

	TUV Mark	EN 62368-1:2020+A11
	CB scheme	IEC 62368-1:2018
	SAA	AS/NZS 62368.1:2022
	EAC	TP TC 004/2011
Safety	СЕ	In conformance with EMC Directive 2014/30/EU and EN IEC 62368-1:2020+A11:2020
	UKCA	In conformance with Electromagnetic Compatibility Regulations 2016 and BS EN IEC 62368- 1:2020+A11:2020
Industrial Control Equipment	UL/cUL listed	UL 508 and CSA C22.2 No. 107.1 (File No. E535363)
1 1 2 1/2	Input to Output	3000Vac
Isolation Voltage	Input to Ground	2000Vac
1 minute, leakage current	Output to Ground	500Vac
5mA max	Output to DC OK	500Vac
Isolation Resistance 500VDC, 25°C, 70%RH	100ΜΩ	
RoHS	RoHS(2011/65/EU) (EU)2015/863	
EMC	CE&RE	Generic Standards: EN 55032:2015+A11:2020 and EN 55035:2017+A11:2020
	ESD	IEC 61000-4-2 Criteria A Air Discharge:8KV Criteria A contact Discharge:4kV
	RS	IEC 61000-4-3 Criteria A 80 MHz to 1000 MHz 3V/m(unmodulated, r.m.s), 1 kHz, 80%, AM modulated
	EFT	IEC 61000-4-4 Criteria A ±1 kV(peak) 5/50ns Tr/Th 5kHz Repetition Frequency

# Safety&EMC Compliance


EMC	Surge	IEC 61000-4-5 Criteria A Differential ±2kV(peak)1.2/50(8/20)Tr/Thμs (line to line) ±2kV(peak)1.2/50(8/20)Tr/Thμs
	CS	(line to earth or ground)  IEC 61000-4-6  Criteria A  0.15MHz to 10MHZ  3V(unmodulated, r.m.s)  10MHz to 30MHZ 3V to  1V(unmodulated, r.m.s)  30MHz to 80MHZ  1V(unmodulated, r.m.s)  1kHz 80%, AM 150Ω source impedance
	DIP	IEC 61000-4-11  Voltage dips: Residual voltage<5% Criteria B  0.5 cycle Residual voltage<70% Criteria C  25 cycle(50Hz), 30 cycle (60Hz)  Voltage interruptions: Residual voltage<5% Criteria C  250 cycle (50Hz),  300 cycle (60Hz)
	PFMFI	IEC 61000-4-8 Criteria A 50Hz or 60Hz 1A/Meter(r.m.s)


#### **Protection Functions**

	24V:28-33V 48V:55-63V			
Over Voltage Protection	<ul><li>(1) When the output voltage meets the above values, it will enter the protection mode.</li><li>(2) Protection mode: Hiccup and auto-restart mode, it will recover automatically</li></ul>			
Over Load Protection	(1)Normally works within 110~150% rated output power for more than 3 seconds and then enter the protection mode.  (2)Protection mode: Hiccup and auto-restart mode, it will recover automatically after output load goes			
Short Circuit Protection	<ul><li>(1)When the V+ output line and the V- output line are shorted, it will enter the protection mode.</li><li>(2)Protection mode: Hiccup and auto-restart mode, it will recover automatically after fault condition is remove.</li></ul>			
Over Current Protection	24V:11-15A  48V:5.5-7.5A  (1)When the output current meets the above values, it will enter the protection mode.  (2)Protection mode: Hiccup and auto-restart mode, it will recover automatically			
Over Temperature protection	(1)Ta:60±3°C (VIN=115VAC; Full load), it will enter the protection mode. (2)Ta:70±3°C (VIN=230VAC; Full load), it will enter the protection mode. (3)Protection mode: Hiccup and auto-restart mode, it will recover automatically after temperature goes down.			

- 1. All parameters are measured at 230VAC input, rated full load and 25  $^{\circ}$ C of ambient temperature, unless otherwise stated.
- 2. Ripple & noise are measured at 20MHz of bandwidth by using a 12" twisted pair-wire terminated with a  $0.1\mu f$  &  $47\mu f$  parallel capacitor.
- ${\tt 3.\,Accuracy:\,includes\,\,set\,\,up\,\,tolerance,\,line\,\,regulation\,\,and\,\,load\,\,regulation.}$
- 4. The power supply is considered a component which will be installed into a final equipment. The final equipment must be re-confirmed that it still meets EMC directives.
- 5. Installation clearances: 40mm on top, 20mm on the bottom, 5mm on the left and right side are recommended when loaded permanently with full power. In case the adjacent device is a heat source. 15mm clearance is recommended.
- 6. Please refer to "Protection & Safety: Over Load Protection".
- 7. Derating may be needed under low input voltage. Please check the "derating curve" for more details.
- 8. After 10 minutes of burn-in.
- 9. The ambient temperature derating of 3.5  $^{\circ}$ C/1000m with fan-less models and of 5  $^{\circ}$ C/1000m with fan models for operating altitude higher than 2000m(6500ft).

## **Dimensions & Lnterface Definition**

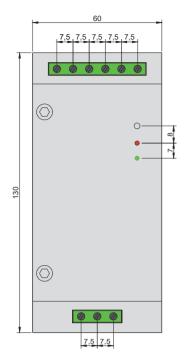


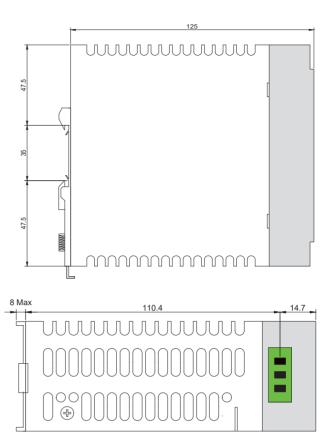




NO	Marking	Assignment	Terminal Wire	
1	DC 014		24.454146	
2	DC OK	Relay Contact	24-16AWG	
3,4	+	DC(+) Output Terminal	24V:16-10AWG	
5,6	-	DC(—) Output Terminal	48V:18-10AWG	
7	L	AC(L) Input Terminal	26-10AWG	
8	N	AC(N) Input Terminal	26-10AWG	
9	<b>+</b>	AC Grounding Terminal	12-10AWG	
/	V-ADJ	DC Output voltage adjustment trimmer	/	
/	(LED)DC OK	DC Output OK LED(Green)	/	
/	(LED)DC LOW	DC Output Low LED(Red)	/	

### **Electrical Curve**

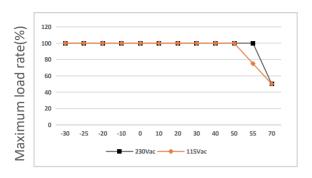

Environmental Temperature(°C)

- 1.If the power supply is continuously used outside the range specified by the derating curve, it may cause degradation or damage to its components. For details, please refer to Figure 1.
- 2. The power supply will have a relatively long rise time when the ambient temperature is between -30°C and -40°C.
- 3.To ensure normal functionality, the power supply must maintain a safe distance from other equipment.
- 4.If the ambient temperature is higher than 50°C, attention must be paid to power derating.

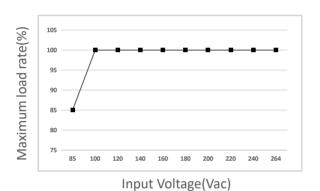


Peak-Load Derating Curve

160
140
120
100
80
60
40
20
0
-40 -30 -20 -10 0 10 20 30 40 50 55 70

For 3 Sec(Typ) Continuous


Environmental Temperature(°C)


## **Block diagram**

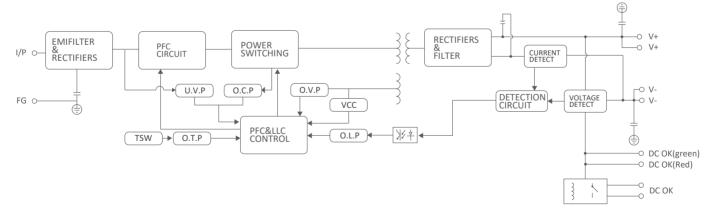

## **Application Note**

1.Series Operation







#### Note:

- 1. Series operation can be connected as shown in above;
- 2. Load current should be less than the current value of the product with the lowest output current specified at the product specification with the power supply at series connection.

#### 2. Errorin Serial Operation (Unavailable)



Parallel Operation A (Unable to use)



Parallel Operation B (Backup)


#### Note:

- 1. Parallel operation should be composed with the same products, while the connection should be as shown as "Parallel operation B";
- 2. In parallel operation B, current capacity cannot be increased, while it should be used forbackup only. Moreover, diode that is to be added during parallel operation should be selected after considering it's voltage drop, output voltage and current capacity.

## **Application Note**


- 3.MountingMethod
  - (1) How to fix

Firstly hang A part on the top of Rail as shown in below, then push the power supply into B direction to fix it.

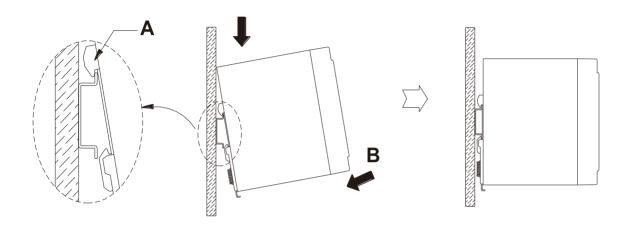

#### (2) Mounting Spacing

Mounting method should be considered with airflow. Leave enough space between the units when several units are mounted together. Forced air cooling makes protection against heat better.

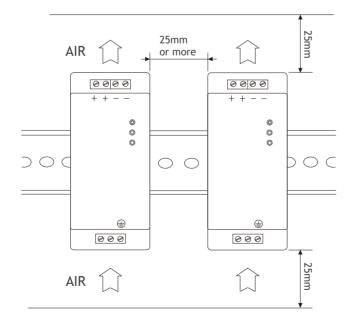

### **Application Note**


#### 4. Cautions

- (1) Please confirm if the capacity of the product is suitable for your intended application beforeputting it in use;
- (2) Only the rated input voltage specified on the product should be used;
- (3) Only the wires with rated capacity should be connected to this product, as allowable voltage and current is varied according to each type of wire;
- (4) Ground terminal of the power supply must be grounded before use to prevent electric shock or electromaganetic interference;
- (5) Be cautions to keep the product clean as foreign matter near the input & output terminal or inside if the product could cause series damages;
- (6) If a fuse installed in the product blows off, the product should experience damages not only to the fuse but also to other parts as well. Therefore, the product is to be required for maintenance work from customer service department as well as replacement of the fuse;
- (7) Due to constant leakage current flows within the product, extra caution should be made if multiple number of products are used connecting to each other as total leakage current could be amounted beyond the capacity;
- (8) Be sure to avoid any physical contact with the product since some of the parts inside of the product are being functioned at high voltage, which could cause serious electric shock;
- (9) For the purpose of safety as well as reliability of the product, please avoid using the product at the following sites:
  - A place near water or fire
  - A place with high room temperature and poor ventilation
  - A place with a presence of foreign objects or dust
  - A place near volatile or flammable compounds
  - A place with high humidity
  - A place vulnerable for vibration or shock
- (10) Do not inspect or repair the product while the power is applied;
- (11) Unauthorized modification should be avoided in order to prevent series injury or physical loss due to any malfunction;
- (12) In case of power outage while in operation, be sure to turn off the power supply.

#### 5. Warranty

- (1) Repair service will be provided for free upon any mechanical, technical or functional defects during the guaranteed warranty, however, any defects or malfunction due to international infliction or negligence by customers will be repaired at the customer's expense;
- (2) Guaranteed warranty of the product runs for 3 years, while appearance and specification of the product is subject for change without any prior notification for the purpose of quality improvement of the product.

### Label

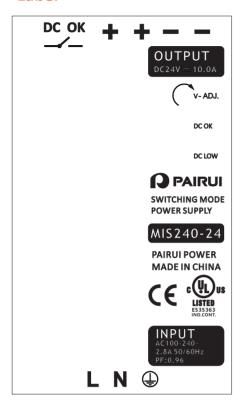







Attention: Used in controlled environments. For environmental conditions, please refer to the manual.

## **Packaging Information**

Quantity per box	Outer Box Size	Net Weight	Gross Weight
(PCS)	L * W * H (mm)	(kg)	(kg)
10	425*320*200	8.8	10.3

# **Change History**

2024-6-8	Publication and distribution
	1. Revise the testing standards for safety and EMC (Electromagnetic Compatibility)
2025-10-10	items.
	2.Add packaging information

October 10, 2025