

MIS75

DIN rail power supplies for 1-phase system AC-DC 75W



Product Family Features

- Universal Input 85~264VAC/127-370VDC;
 Support transient voltage: 305VAC/1H
- Cooling by Free Air Convection
- All Round Protections: SCP/OLP/OVP/OCP/OTP
- LED Indicator for DC Power On; LED Indicator for DC Low
- BS EN/EN61000-6-2(BS EN/EN50082-2) /UL62368(Safety)
- Built-in active PFC function
- 140% Peak Load capability



Models

Model Number	Output Voltage	Input Voltage	Output Current	Efficiency	Ripple
MIS75-12	12V	85-264Vac	6.25A	89%	100mV
MIS75-24	24V	85-264Vac	3.13A	89%	120mV
MIS75-48	48V	85-264Vac	1.56A	89%	120mV

Input Specifications

Parameter	Min.	Тур.	Max.	Note
Input Voltage Range (AC)	85V	230V	264V	Support transient voltage: 305VAC/1H; Input voltage for Safety certification: 100-240VAC
Input Voltage Range (DC)	127V	-	370V	
Input Frequency	50Hz	-	60Hz	
Nominal Input Voltage	100V	-	240V	
	-	-	1.5A	115Vac&full load
Input current	-	-	0.85A	230Vac&full load
Inrush Current	-	-	40A	115Vac&full load
Cold Start	-	-	70A	230Vac&full load
Leakage Current	-	-	1mA	230Vac&full load

^{*} The power supply can operate with DC input. Please connect the positive terminal to the L terminal and the negative terminal to the N terminal.

Output Specifications

Parameter	Min.	Тур.	Max.	Note
Output Voltage Accuracy	-	-	±0.5%	
Line Regulation	-	-	±1%	
Load Regulation IOUT=0%~100% of IOUT,Rated	-	-	±1%	
	12	-	14	MIS75-12
Output Voltage adjust- range	24	-	28	MIS75-24
	48	-	55	MIS75-48

General Specifications

Parameter	Min.	Тур.	Max.	Note
Temperature Coefficiency	-	-	±0.03%/°C	0~50°C
-	-	-	1000mS	115Vac&full load
Turn-on time	-	-	500mS	230Vac&full load
	-	-	20mS	115Vac&full load
Hold-up time	-	-	30mS	230Vac&full load
Discotions	60mS	-	-	115Vac&full load
Rise time	60mS	-	-	230Vac&full load
Recommended External Fuse	-	-	-	
Operating Temperature Range	-30°C	-	70°C	
Storage Temperature	-40°C	-	85°C	
Storage Humidity	20%	-	95%	non-condensing
Operating Altitude	0m	-	5000m	
Case Material	Stainless steel	+ aluminum		
Cooling Method	Air convection cooling			
Vibration	Component: 10~500Hz, 2G 10min./1cycle, period for 60min. each along X, Y, Z axes (IEC60068-2-6)			
MTBF	230Khrs,MIL-HDBK-217F(25°C)			
Size	30.0*130.0*125.0mm (1.18*5.12*4.92inch)			
Weight	622g			

Safety&EMC Compliance

Safety & Elvie Compilative				
	TUV Mark		EN 62368-1:2020+A11	
	CB scheme		IEC 62368-1:2018	
	SAA		AS/NZS 62368.1:2022	
Safety	EAC		TP TC 004/2011	
	CE		In conformance with EMC Directive 2014/30/EU and EN IEC 62368-1:2020+A11:2020	
	UKCA		EN IEC 62368-1:2020+A11:2020 In conformance with EMC Directive 2014/30/EU	
Industrial Control Equipment	UL/cUL listed		CSA C22.2 No. 107.1 (File No. E535363)	
	Input to Output	3000Vac		
Isolation Voltage	Input to Ground	2000Vac		
1 minute, leakage current	Output to Ground	500Vac		
5mA max	Output to DC OK	500Vac		
Isolation Resistance 500VDC, 25°C, 70%RH	100Μ Ω			
RoHS	RoHS(2011/65/EU) (EU)2015/863			
	CE&RE		Generic Standards: EN 55032:2015+A11:2020 EN 55035:2017+A11:2020	
EMC	ESD		IEC 61000-4-2 Criteria A Air Discharge:8KV Criteria A contact Discharge:4kV	
	RS		IEC 61000-4-3 Criteria A 80 MHz to 1000 MHz 3V/m(unmodulated, r.m.s), 1 kHz, 80%, AM modulated	
	EFT		IEC 61000-4-4 Criteria A ±2 kV(peak) 5/50ns Tr/Th 5kHz Repetition Frequency	

Safety&EMC Compliance

EMC	Surge	IEC 61000-4-5 Criteria A Differential ±2kV(peak)1.2/50(8/20)Tr/Thμs (line to line) ±4kV(peak)1.2/50(8/20)Tr/Thμs (line to earth or ground)
	CS	IEC 61000 -4-6 0.15 MHz to 80 MHZ 10V(unmodulated, r.m.s), 1kHz 80% , AM $150~\Omega$ source impedance
	DIP	IEC 61000-4-11 Voltage dips: >95 % reduction Criteria B 0.5 period >30% reduction Criteria C 25 cycle(50Hz), 30 cycle (60Hz) Voltage interruptions: >95 % reduction Criteria C 250 cycle (50Hz), 300 cycle (60Hz
	PFMFI	IEC 61000-4-8 Criteria A 50Hz or 60Hz 30A/Meter(r.m.s)

Protection Functions


	12V:15-17V	24V:28-32V	48V:60-65V		
Over Voltage Protection	(1)When the output voltage meets the above values, it will enter the protection mode.(2)Protection mode: Hiccup and auto-restart mode, it will recover automatically after output voltage goes down.				
Over Load Protection	(1)Normally works within 110~140% rated output power for more than 3 seconds and then enter the protection mode. (2)Protection mode: Hiccup and auto-restart mode, it will recover automatically after output load goes down.				
Short Circuit Protection	(1) When the V+ output line and the V- output line are shorted, it will enter the protection mode. (2) Protection mode: Hiccup and auto-restart mode, it will recover automatically after fault condition is remove.				
	12V:6.87-8.75A	24V:11-15A	48V:5.5-7.5A		
Over Current Protection	(1) When the output current meets the above values, it will enter the protection mode.(2) Protection mode: Hiccup and auto-restart mode, it will recover automatically after output current goes down.				
Over Temperature protection	(1)Ta:65±5°C (VIN=115VAC; Full load), it will enter the protection mode. (2)Ta:65±5°C (VIN=230VAC; Full load), it will enter the protection mode. (3)Protection mode: Hiccup and auto-restart mode, it will recover automatically after temperature goes down.				


- 1. All parameters are measured at 230VAC input, rated full load and 25°C of ambient temperature, unless otherwise stated.
- 2. Ripple & noise are measured at 20MHz of bandwidth by using a 12" twisted pair-wire terminated with a 0.1μf & 47μf parallel capacitor.
- 3. Accuracy: includes set up tolerance, line regulation and load regulation.
- 4. The power supply is considered a component which will be installed into a final equipment. The final equipment must be re-confirmed that it still meets EMC directives.
- 5. Installation clearances: 40mm on top, 20mm on the bottom, 5mm on the left and right side are recommended when loaded permanently with full power. In case the adjacent device is a heat source. 15mm clearance is recommended.
- 6. Please refer to "Protection & Safety: Over Load Protection".
- 7. Derating may be needed under low input voltage. Please check the "derating curve" for more details.
- 8. After 10 minutes of burn-in.
- 9. The ambient temperature derating of 3.5° C/1000m with fan-less models and of 5° C/1000m with fan models for operating altitude higher than 2000m(6500ft).

Dimensions & Lnterface Definition



Unit: mm Tolerance:±0.5mm

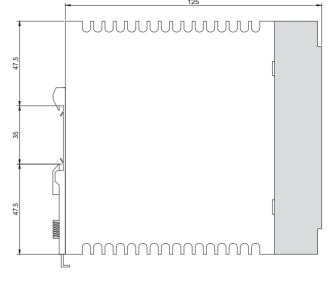







NO	Marking	Assignment	Terminal Wire
1	DC 01/		24.464346
2	DC OK	Relay Contact	24-16AWG
3	+	DC(+) Output Terminal	24V:16-10AWG
4	-	DC(—) Output Terminal	48V:18-10AWG
5	L	AC(L) Input Terminal	26-10AWG
6	N	AC(N) Input Terminal	26-10AWG
7	<u>-</u>	AC Grounding Terminal	12-10AWG
/	V-ADJ	DC Output voltage adjustment trimmer	/
/	(LED)DC OK	DC Output OK LED(Green)	/
/	(LED)DC LOW	DC Output Low LED(Red)	/

Electrical Curve




Environmental Temperature(°C)

- 1.If the power supply is continuously used outside the range specified by the derating curve, it may cause degradation or damage to its components. For details, please refer to Figure 1.
- 2. The power supply will have a relatively long rise time when the ambient temperature is between -30°C and -40°C.
- 3.To ensure normal functionality, the power supply must maintain a safe distance from other equipment.
- 4.If the ambient temperature is higher than 50°C, attention must be paid to power derating.




Input Voltage(Vac)

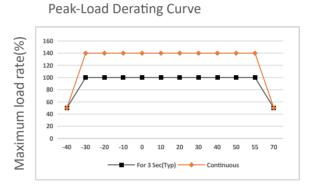


Environmental Temperature(°C)


Block diagram

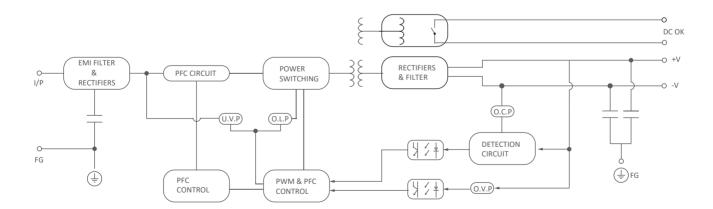

Application Note

1.Series Operation







Note:

- 1. Series operation can be connected as shown in above;
- 2. Load current should be less than the current value of the product with the lowest output current specified at the product specification with the power supply at series connection.

2.Series Operation



Parallel Operation A (Unable to use)



Parallel Operation B (Backup)


Note:

- 1. Parallel operation should be composed with the same products, while the connection should be as shown as "Parallel operation B";
- 2. In parallel operation B, current capacity cannot be increased, while it should be used forbackup only. Moreover, diode that is to be added during parallel operation should be selected after considering it's voltage drop, output voltage and current capacity.

Application Note


- 3.MountingMethod
 - (1) How to fix

Firstly hang A part on the top of Rail as shown in below, then push the power supply into B direction to fix it.

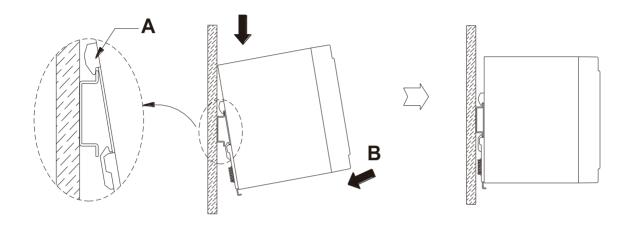

(2) Mounting Spacing

Mounting method should be considered with airflow. Leave enough space between the units when several units are mounted together. Forced air cooling makes protection against heat better.

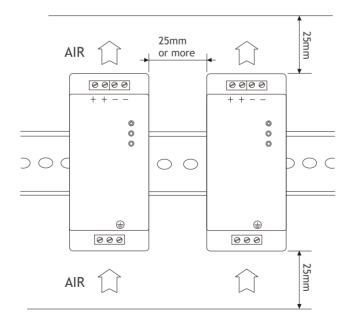

Application Note

4. Cautions

- (1) Please confirm if the capacity of the product is suitable for your intended application beforeputting it in use;
- (2) Only the rated input voltage specified on the product should be used;
- (3) Only the wires with rated capacity should be connected to this product, as allowable voltage and current is varied according to each type of wire;
- (4) Ground terminal of the power supply must be grounded before use to prevent electric shock or electromaganetic interference;
- (5) Be cautions to keep the product clean as foreign matter near the input & output terminal or inside if the product could cause series damages;
- (6) If a fuse installed in the product blows off, the product should experience damages not only to the fuse but also to other parts as well. Therefore, the product is to be required for maintenance work from customer service department as well as replacement of the fuse;
- (7) Due to constant leakage current flows within the product, extra caution should be made if multiple number of products are used connecting to each other as total leakage current could be amounted beyond the capacity;
- (8) Be sure to avoid any physical contact with the product since some of the parts inside of the product are being functioned at high voltage, which could cause serious electric shock;
- (9) For the purpose of safety as well as reliability of the product, please avoid using the product at the following sites:
 - A place near water or fire
 - A place with high room temperature and poor ventilation
 - A place with a presence of foreign subject or dust
 - A place near volatile or flammable compounds
 - A place with high humidity
 - A place vulnerable for vibration or shock
- (10) Do not inspect or repair the product while the power is applied;
- (11) Unauthorized modification should be avoided in order to prevent series injury or physical loss due to any malfunction;
- (12) In case of power outage while in operation, be sure to turn off the power supply.


5. Warranty

- (1) Repair service will be provided for free upon any mechanical, technical or functional defects during the guaranteed warranty, however, any defects or malfunction due to international infliction or negligence by customers will be repaired at the customer's expense;
- (2) Guaranteed warranty of the product runs for 3 years, while appearance and specification of the product is subject for change without any prior notification for the purpose of quality improvement of the product.

Label





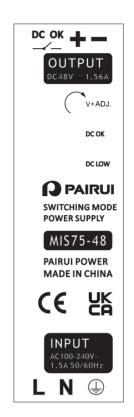







Attention: Used in controlled environments. For environmental conditions, please refer to the manual. REMARQUE: Implementing Resource Utilization in Environmental Control

Packaging Information

Quantity per box	Outer Box Size	Net Weight	Gross Weight
(PCS)	L * W * H (mm)	(kg)	(kg)
15	425*320*200	9.3	10.8

Change History

2024-6-8	Publication and distribution
	1. Revise the testing standards for safety and EMC (Electromagnetic Compatibility)
2025-10-10	items.
	2.Add packaging information